

PROLON



---

# QUICK START **GUIDE**

C1000 SERIES

---

[www.proloncontrols.com](http://www.proloncontrols.com) | [info@proloncontrols.com](mailto:info@proloncontrols.com)

17 510 rue Charles, Suite 100, Mirabel, QC, J7J 1X9

REV. 3.0  
PL-QCK-C1000-EN


## Table of Contents

Staged Boiler Controller (PL-C1000-BLR).....	4
Modulating Boiler Controller (PL-C1000-BLR) .....	6
Chiller Controller (PL-C1000-CHL).....	8
FlexIO Controller (PL-C1000-FLX).....	10
Heatpump Controller (PL-C1000-HP & PL-C1000-HPS) .....	12
Humidity Controller (PL-C1000-HU) .....	14
Rooftop Controller (PL-C1000-RTU & PL-C1000-RTUS).....	16
Water Loop Controller (PL-C1000-WLC).....	18
Compliance.....	20
Technical Specifications .....	20


© Copyright 2020 Prolon. All rights reserved.

No part of this document may be photocopied or reproduced by any means, or translated to another language without prior written consent of Prolon. All specifications are nominal and may change as design improvements are introduced. Prolon shall not be liable for damages resulting from misapplication or misuse of its products. All trademarks are the property of their respective owners.


# Staged Boiler Controller (PL-C1000-BLR)

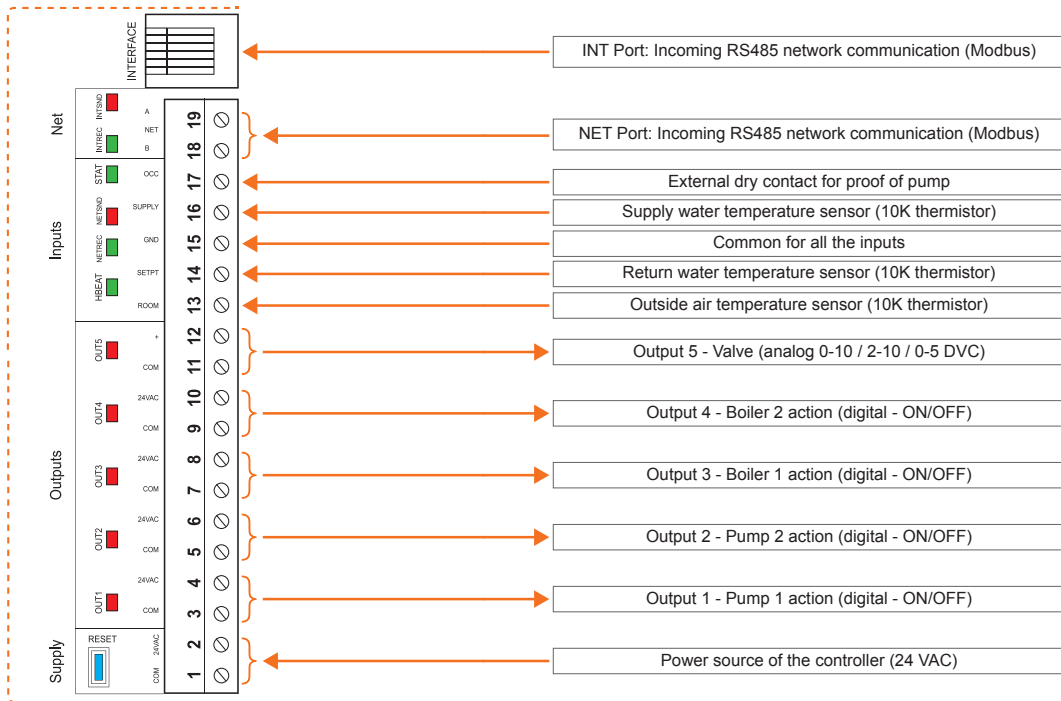


# Modulating Boiler Controller (PL-C1000-BLR)

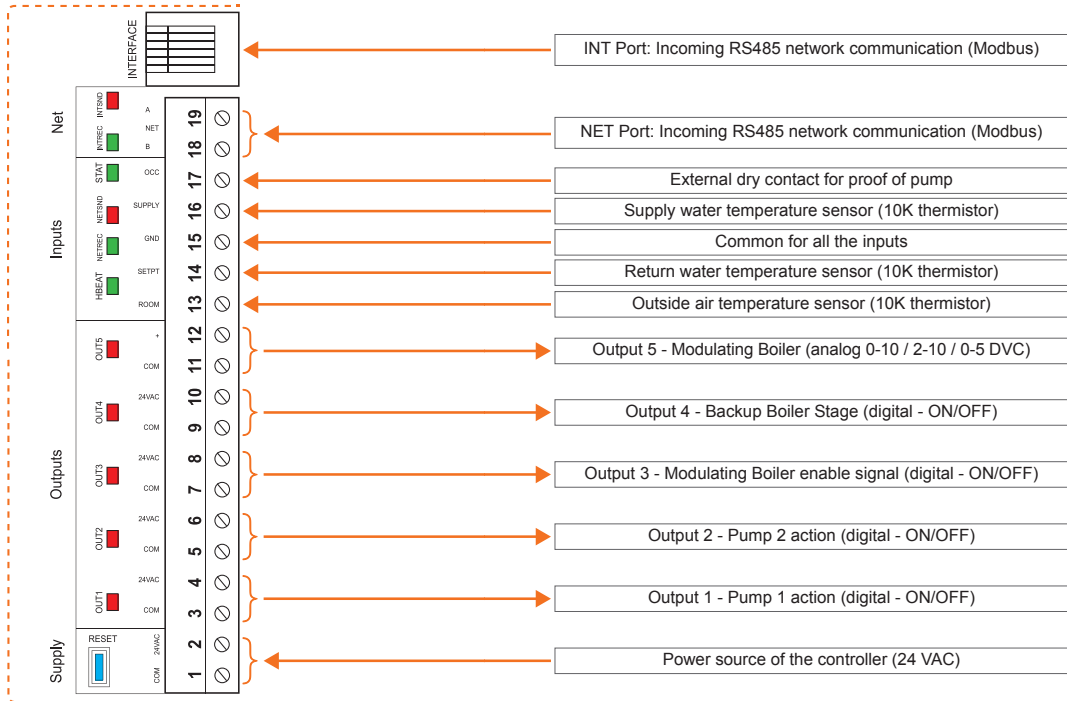


# Chiller Controller (PL-C1000-CHL)

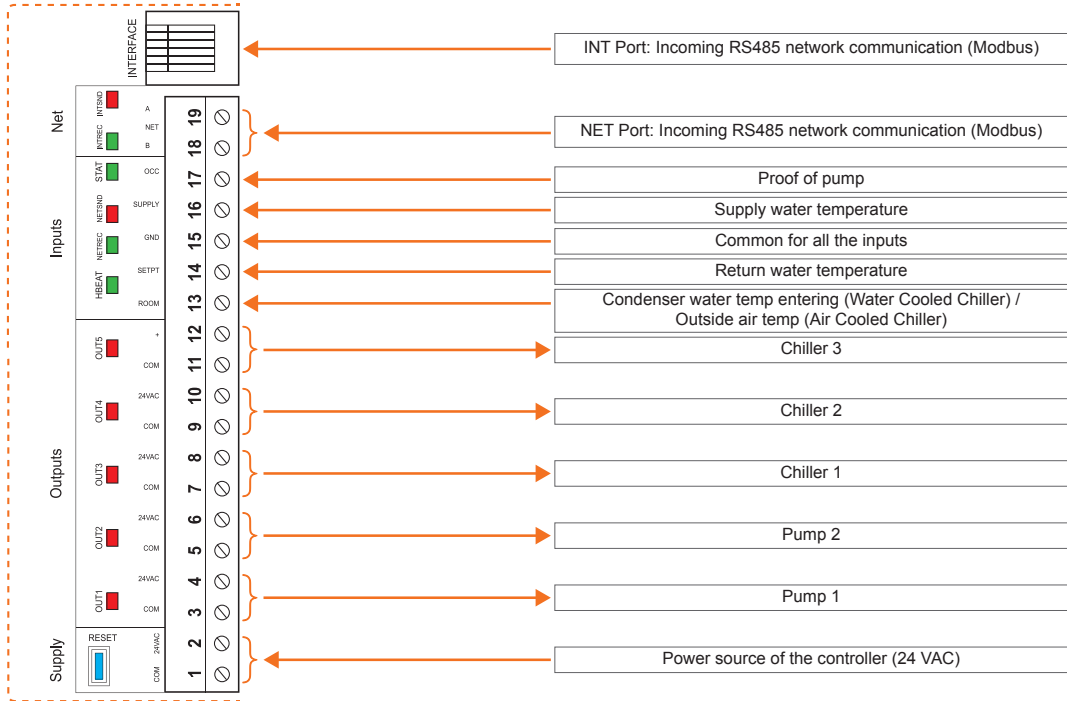


# FlexIO Controller (PL-C1000-FLX)

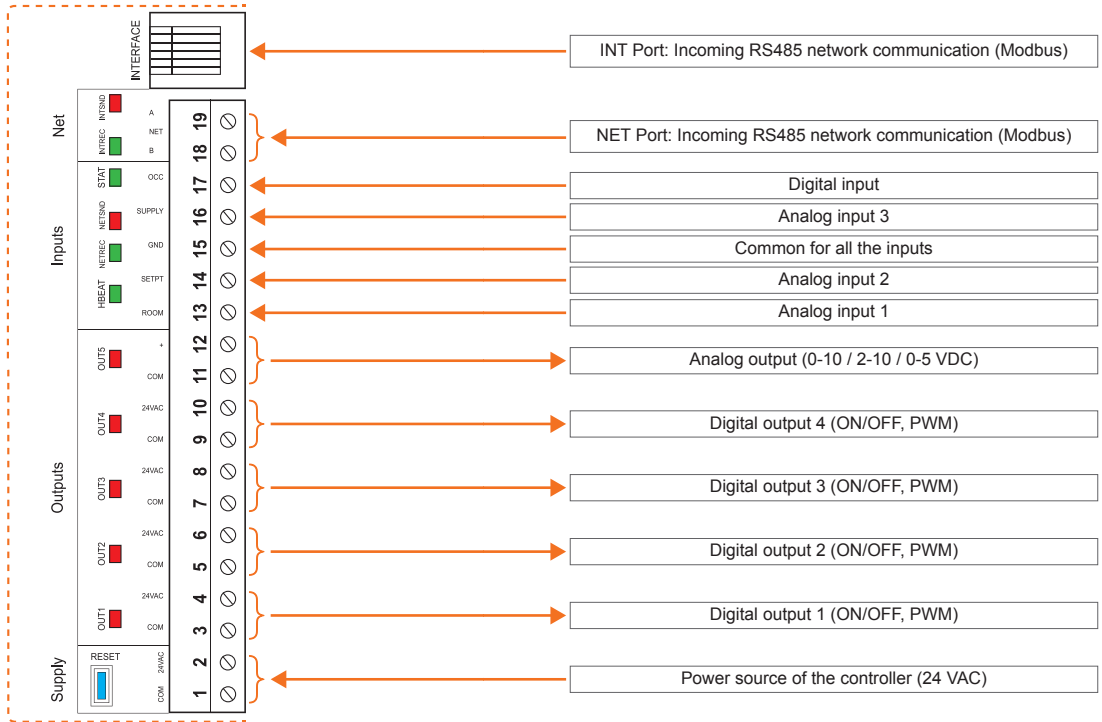

# Heatpump Controller (PL-C1000-HP & PL-C1000-HPS)

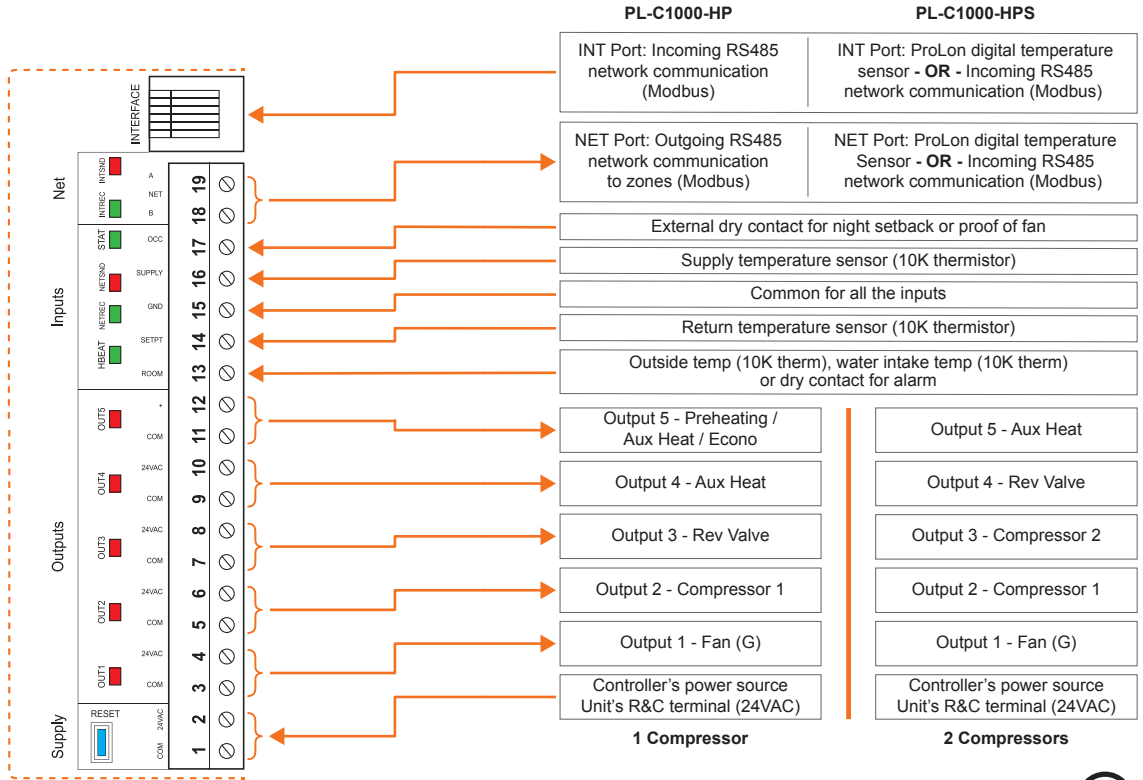


# Humidity Controller (PL-C1000-HU)

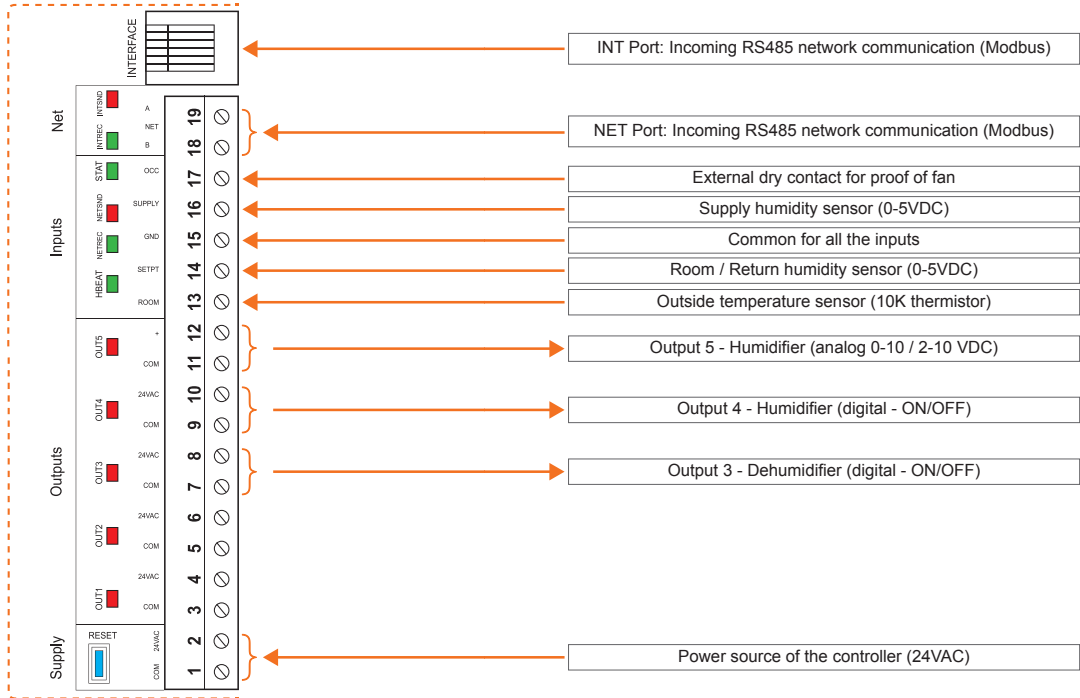



# Rooftop Controller (PL-C1000-RTU & PL-C1000-RTUS)

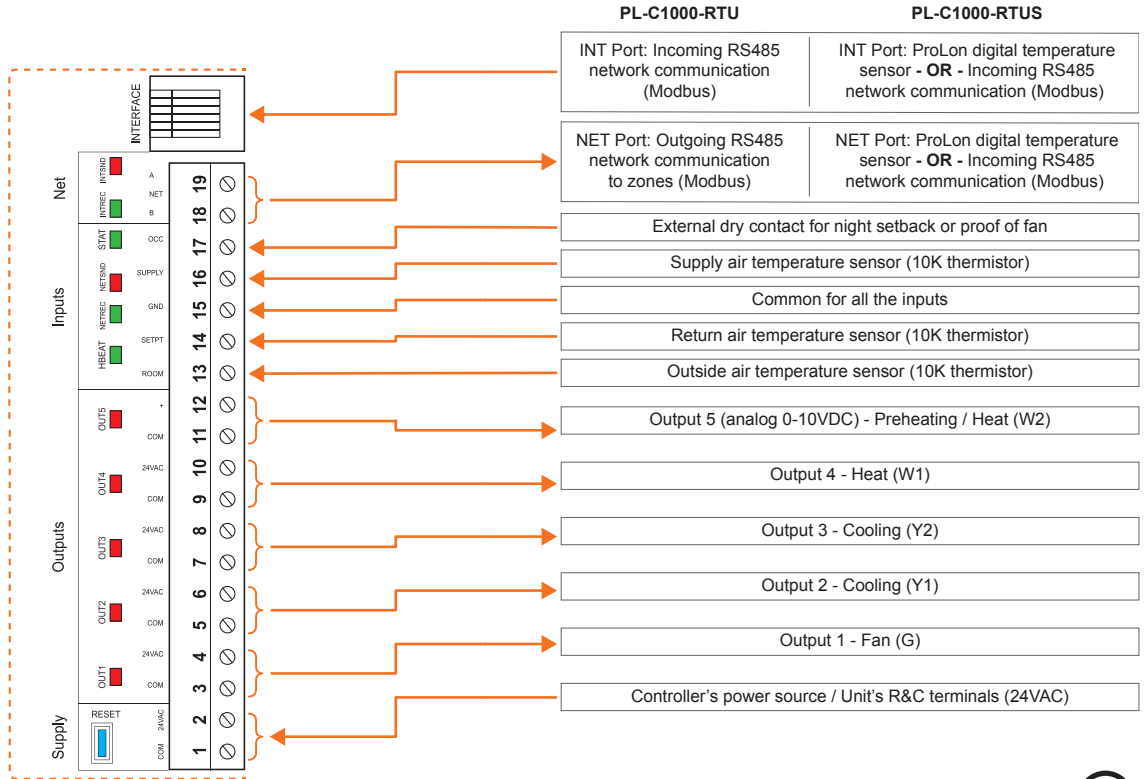


32-122 °F (0-50 °C) Non-condensing

cULus Listed; UL 916 Energy Management Equipment, File E364757, Vol.1



# Water Loop Controller (PL-C1000-WLC)

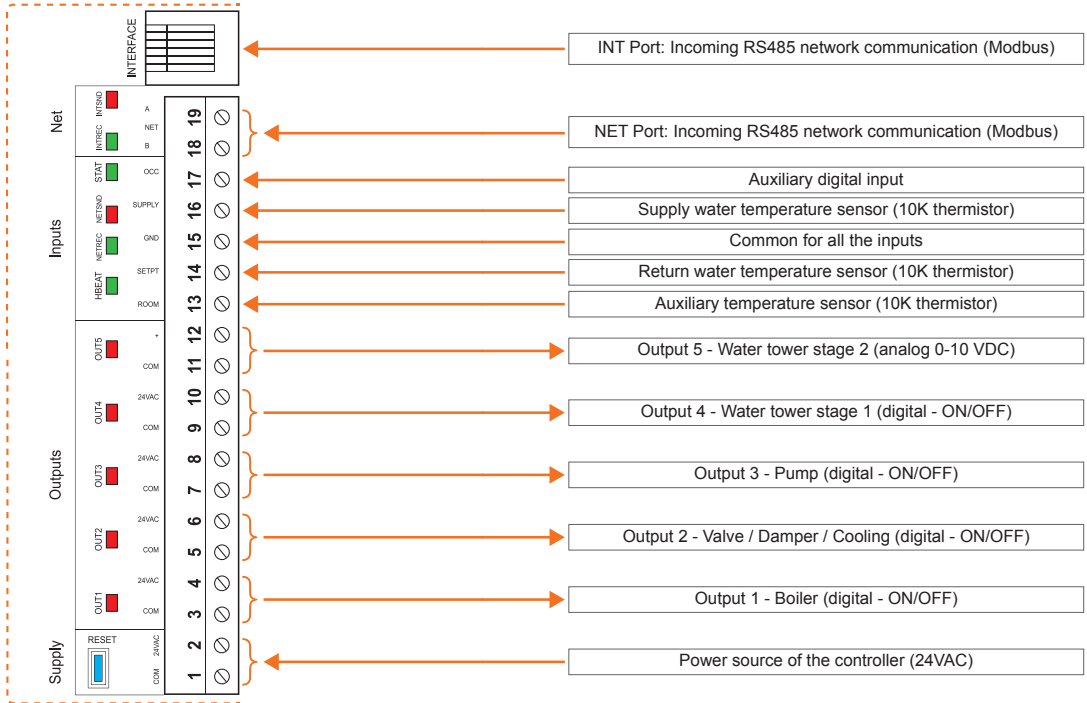

## Compliance

- cULus Listed; UL 916 Energy Management Equipment, File E364757, Vol.1
- FCC Compliant to CFR47, Part 15, Subpart B, Class B
- Industry Canada (IC) Compliant to ICES-003, Issue 5: CAN ICES-3 (B) / NMB-3(B)
- RoHS Directive (2002/95/EC)

### FCC User Information

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

### Industry Canada

This Class (B) digital apparatus meets all the requirements of the Canadian Interference-Causing Equipment regulations.

Cet appareil numérique de la Classe (B) respecte toutes les exigences du Règlement sur le matériel brouilleur du Canada.

## Technical Specifications

**Supply:** 24 VAC  $\pm$ 10%, 50/60 Hz, Class 2

**Power:** 2 VA (consumption), 40 VA (Input)