


PL-PN2-1A-7K / PL-PN2-1B-7K

VERSION 6

Internal Electrical Wiring Diagram

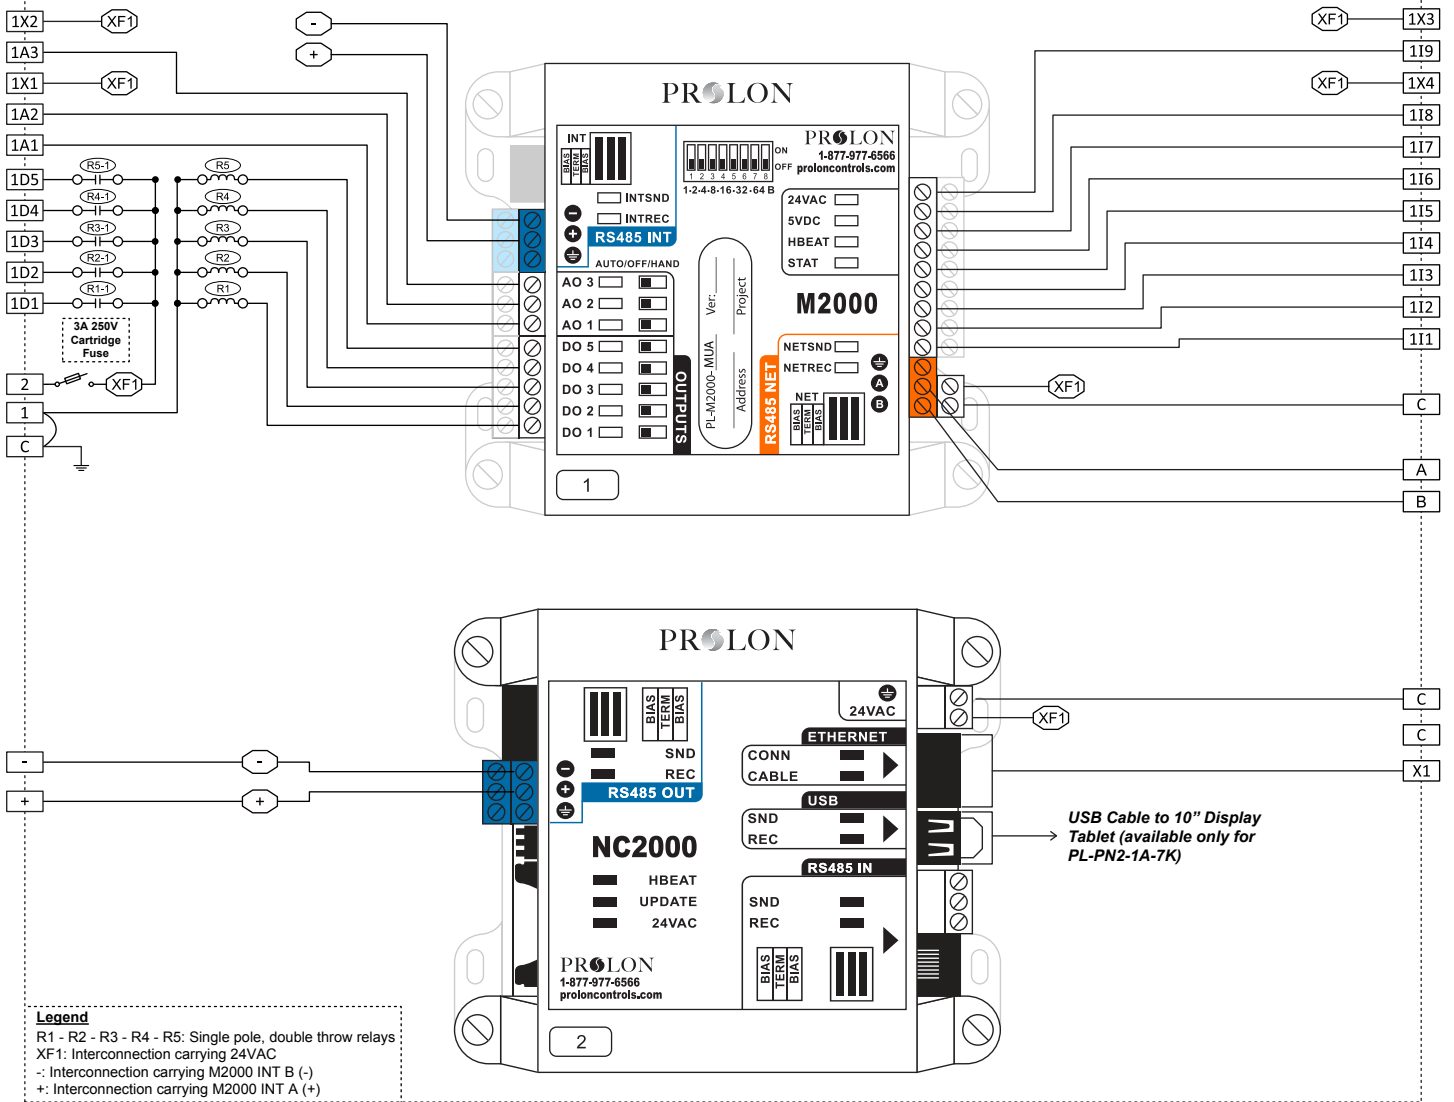

Field Wiring Details

ALL TERMINALS: Use Copper Conductors Only, 105°C/220°F, Maximum Torque Conductor Mounting: 0.5Nm

Terminal	Function	Ratings
⏚	GROUND	N/A
1	Power Supply Input Common	N/A
2	Power Supply Input 24VAC	24VAC, 3A, 60Hz
1D1	(R1) - Occupancy Output	24VAC, 300mA
1D2	(R2) - Outside Air Damper Output	24VAC, 300mA
1D3	(R3) - Fan Output	24VAC, 300mA
1D4	(R4) - Preheat Permission Output	24VAC, 300mA
1D5	(R5) - Alarm Output	24VAC, 300mA
1A1	Modulating Heat Output	0-10VDC, 40mA
1A2	Cooling Output	0-10VDC, 40mA
1X1	Power 24VAC Supply	24VAC, 8.5VA
1A3	VFD Output	0-10VDC, 40mA
1X2	VFD Supply	24VAC, 5VA
1X3	Static Pressure Sensor Supply	24VAC, 0.03A
1I9	CO2 / Building Pressure	5VDC, 20mA

Terminal	Function	Ratings
1X4	CO2 Sensor Supply	24VAC, 6.7VA
1I8	Zone Temperature	N/A
1I7	Outside Temperature	N/A
1I6	Supply Temperature	N/A
1I5	Dry Contact for Manual Reset	N/A
1I4	Dry Contact for Proof of Fan	N/A
1I3	Dry Contact for Outside Air Damper	N/A
1I2	Dry Contact for: Exhaust 2 / Manual Override	N/A
1I1	Dry Contact for Exhaust 1	N/A
+	NC2000 / M2000 RS485 INT A (+)	N/A
-	NC2000 / M2000 RS485 INT B (-)	N/A
A	M2000 RS485 NET A (+)	N/A
B	M2000 RS485 NET B (-)	N/A
X1	NC2000 Ethernet Connection (Use CAT5e Patch Cable)	N/A
C	COMMON	N/A

PROLON

1-877-9PROLON

www.proloncontrols.com

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

info@proloncontrols.com